

Test Time: 2025-09-23 16:22

## Luminaire Property

Luminous Length (mm): -430

Voltage: 231.5 V

Power: 19.70 W

Current: 0.090 A

Power Factor: 0.941

## Photometric Results

Total Rated Lamp Lumens: 1831.5 lm

Efficiency: 100%

Upward Ratio: 0%

Horizontal Diffuse Angle(50%): H84.5



Vertical Diffuse Angle(50%): V84.5

Central Intensity: 996.14 cd

Pos of Max. Intensity: H0 V1

S/MH(C90/C270): 1.15

### Luminous Intensity Distribution Curve

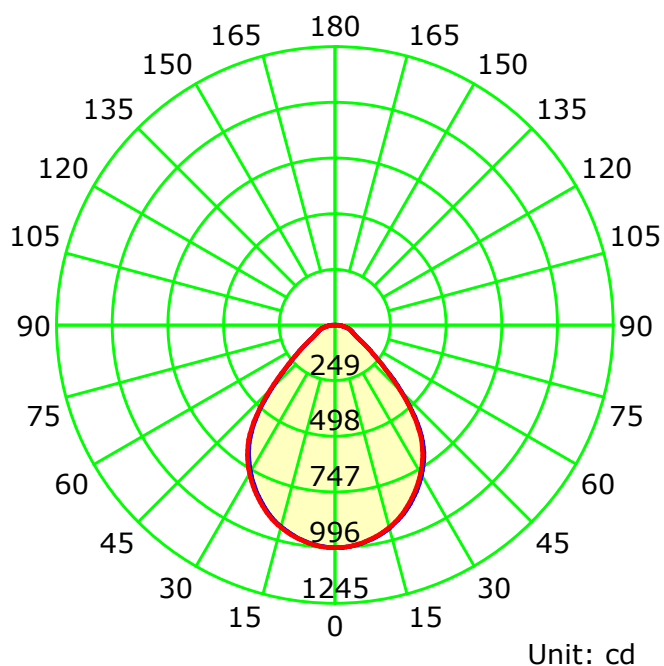

— C0-C180 — C90-C270

Gamma Plane (°):0.0-90.0:1.0



Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:


## Luminous Intensity Distribution Curve

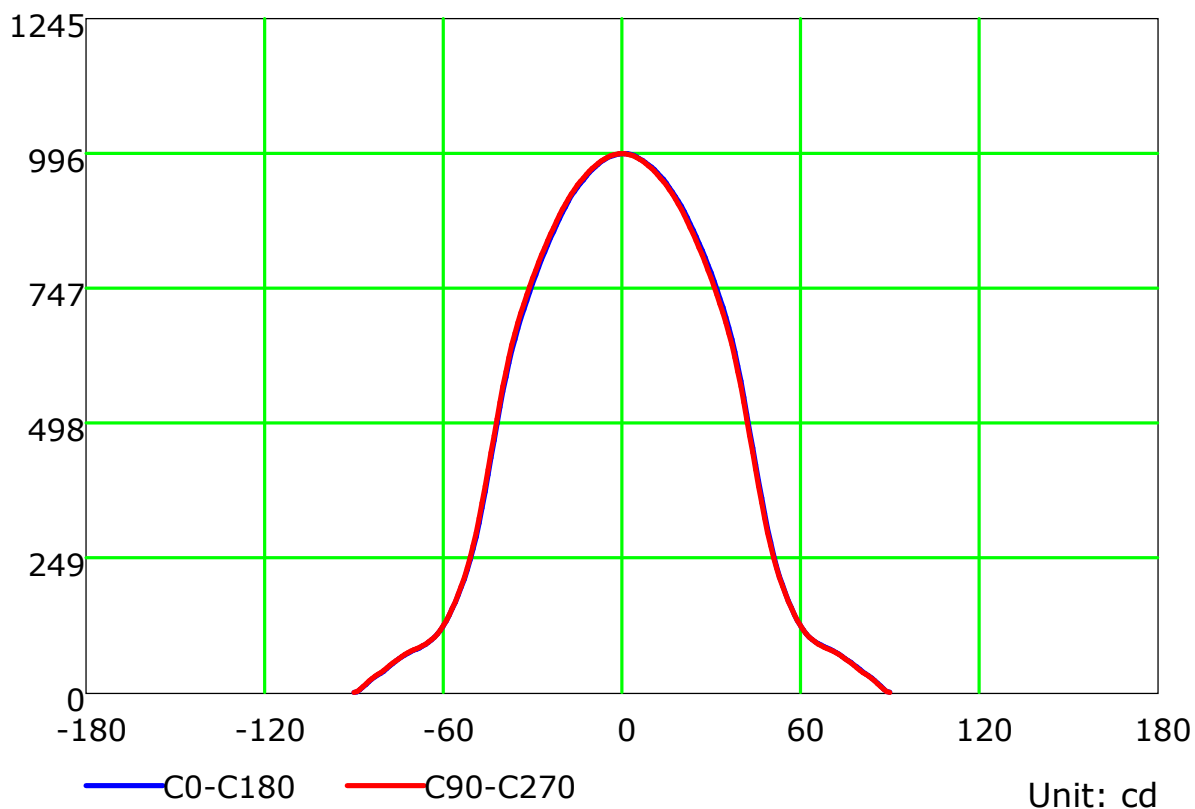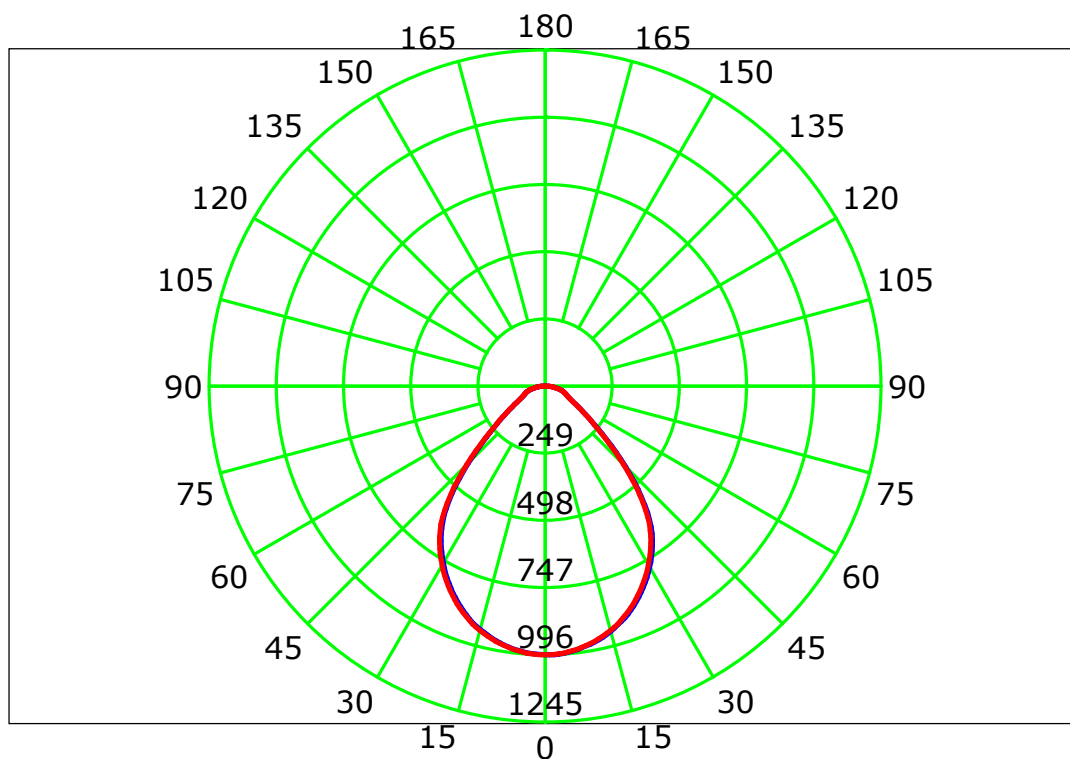

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:


## Luminous Intensity Distribution Curve(cd/klm)

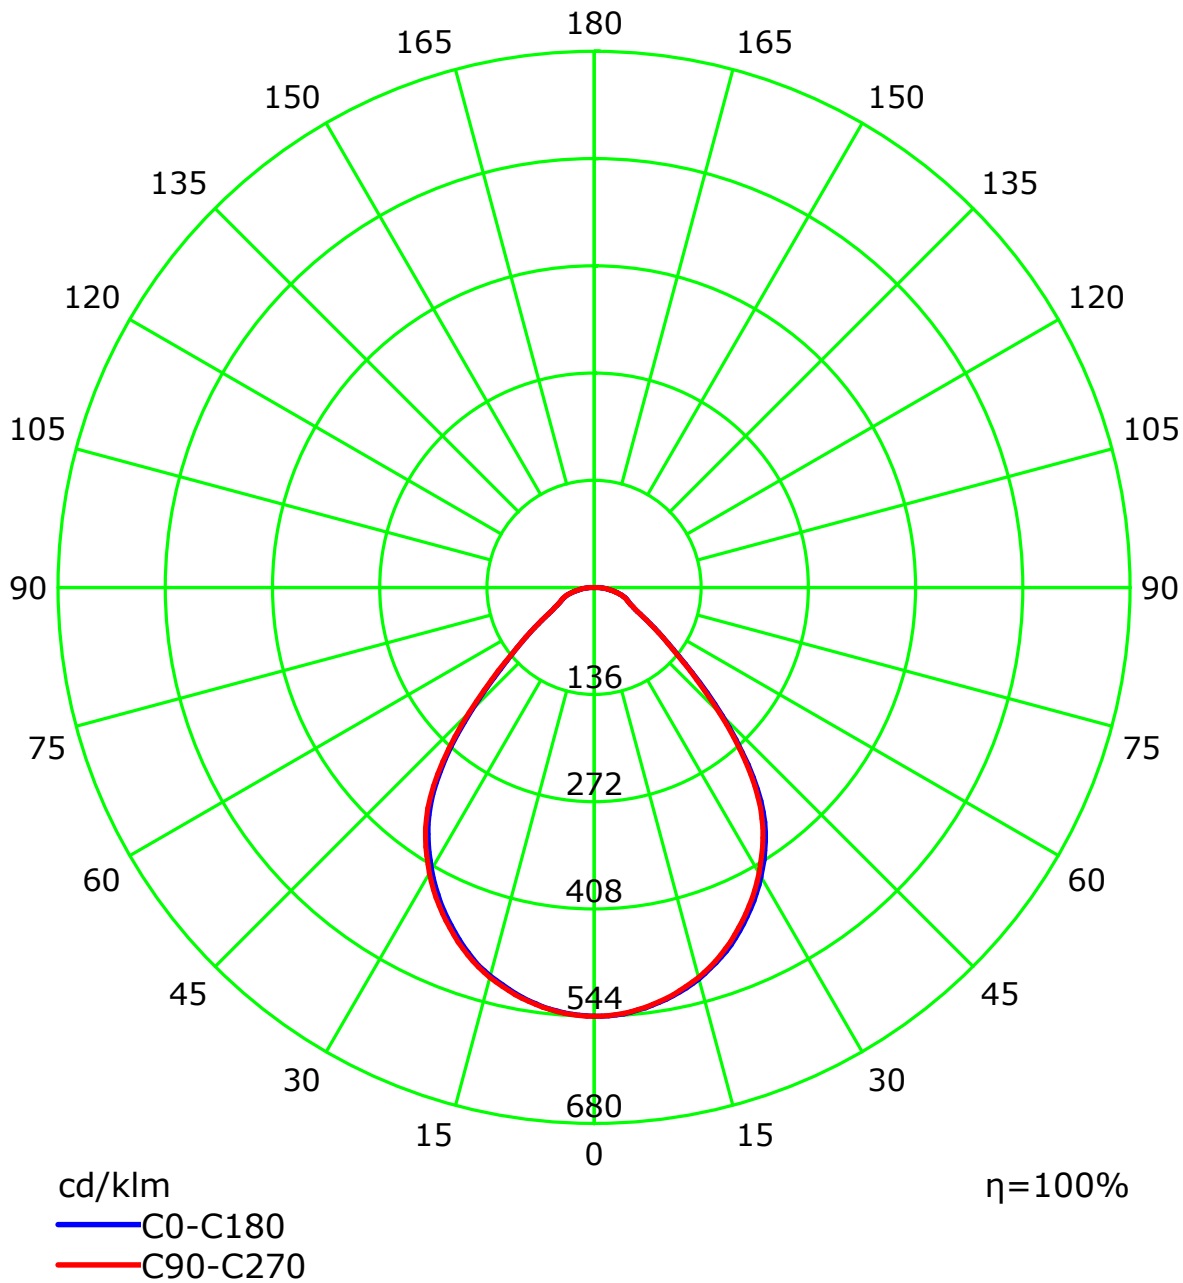

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Isocandela (rectangle)

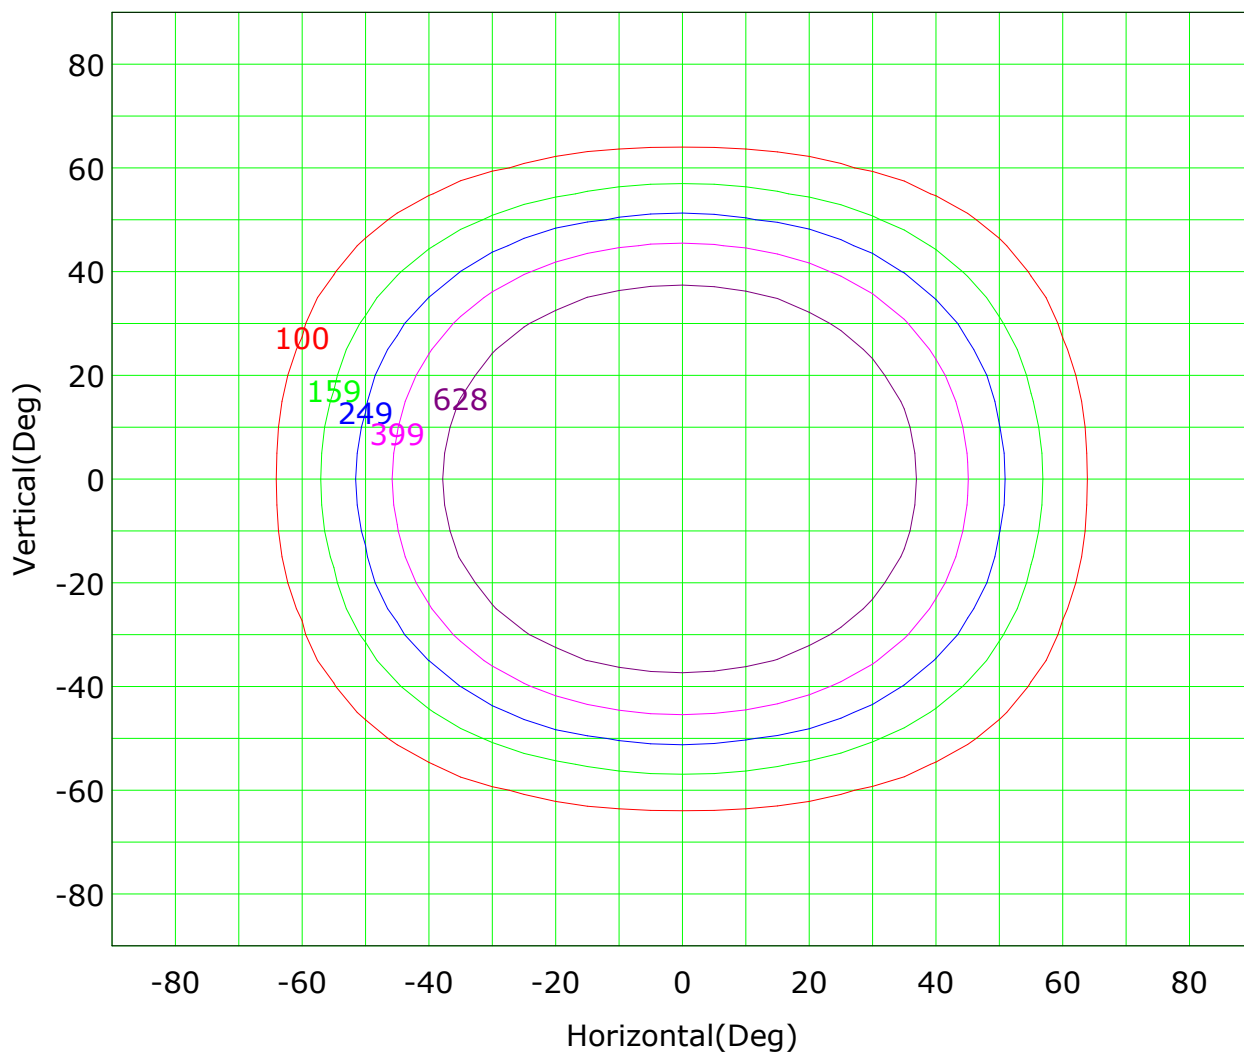

Imax (100%): 996 cd

( 10%):	100 cd	( 16%):	159 cd
( 25%):	249 cd	( 40%):	399 cd
( 63%):	628 cd	(100%):	996 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

## IsoLux Plot

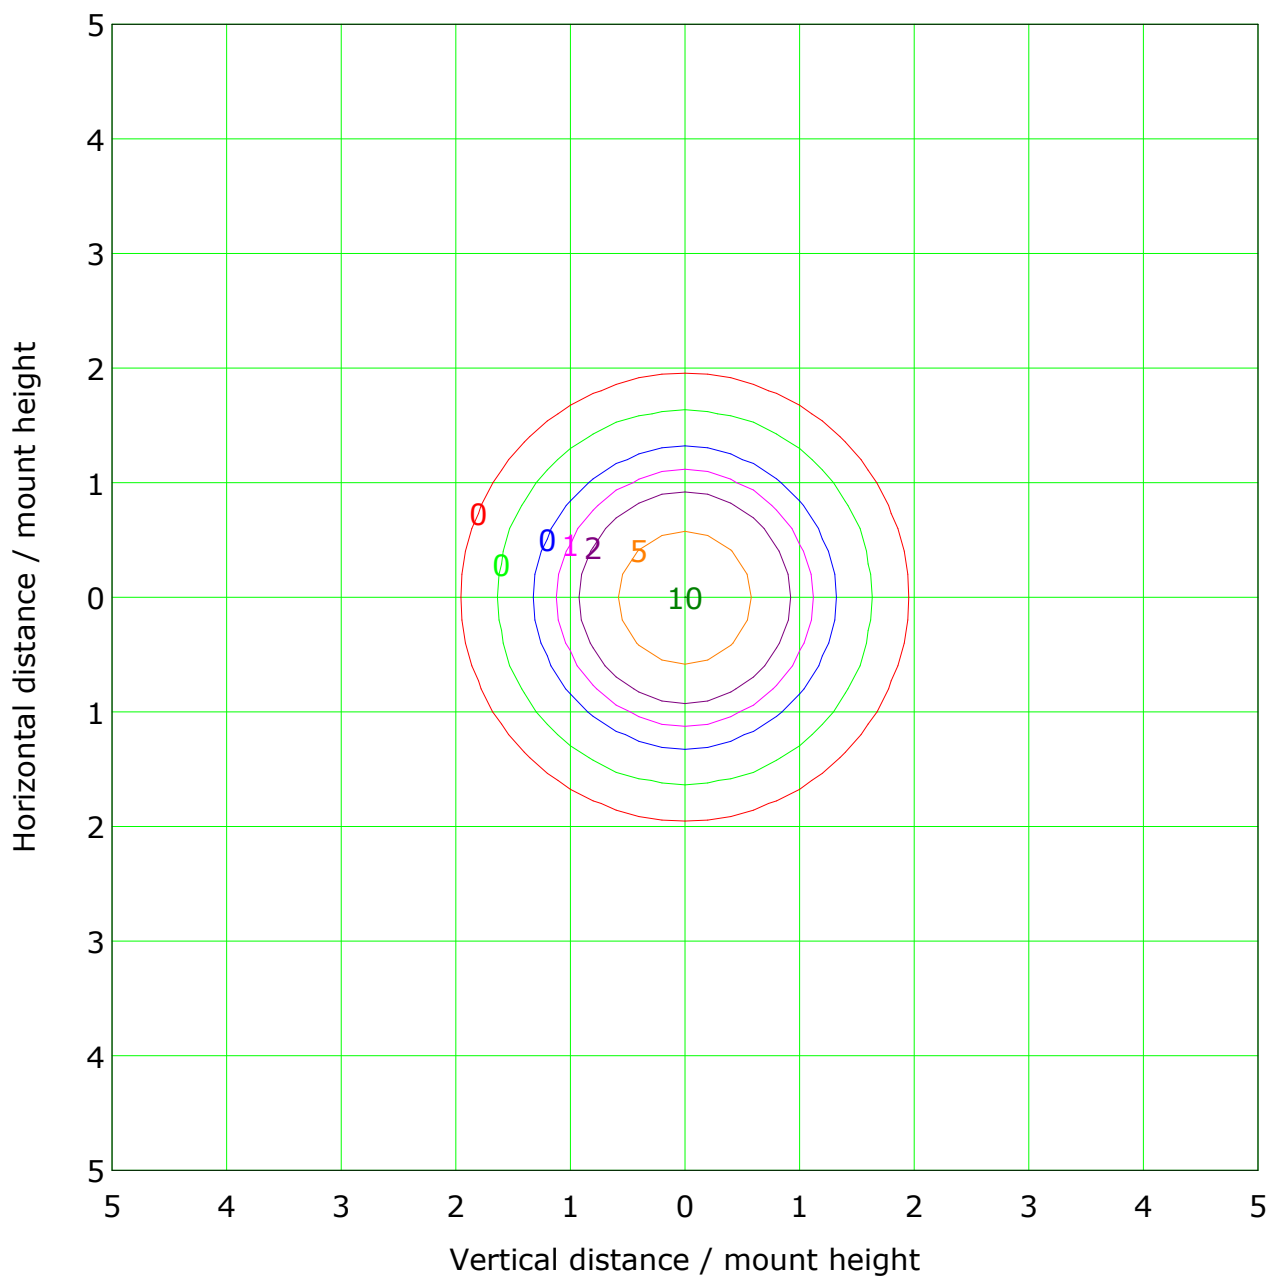

Mounting Height: 10.0m    Max Lux(100%): 10.0 lx

( 1%): 0.1 lx	( 2%): 0.2 lx
( 5%): 0.5 lx	( 10%): 1.0 lx
( 20%): 2.0 lx	( 50%): 5.0 lx
(100%): 10.0 lx	

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 2.905 m


Humidity:

Inspector:

## Illuminance at a Distance

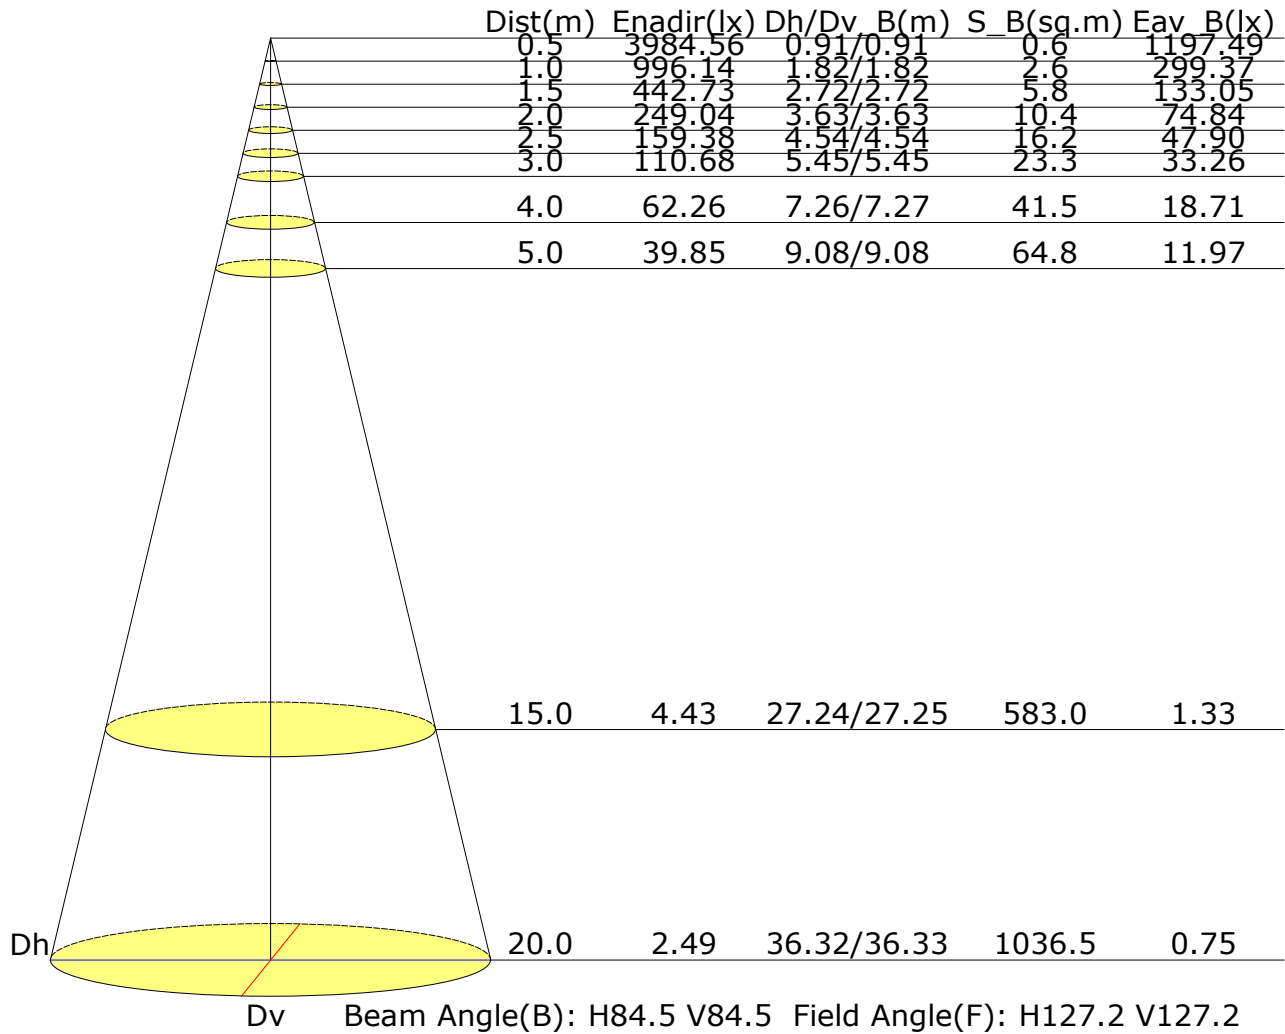

## Vertical IsoLux Plot

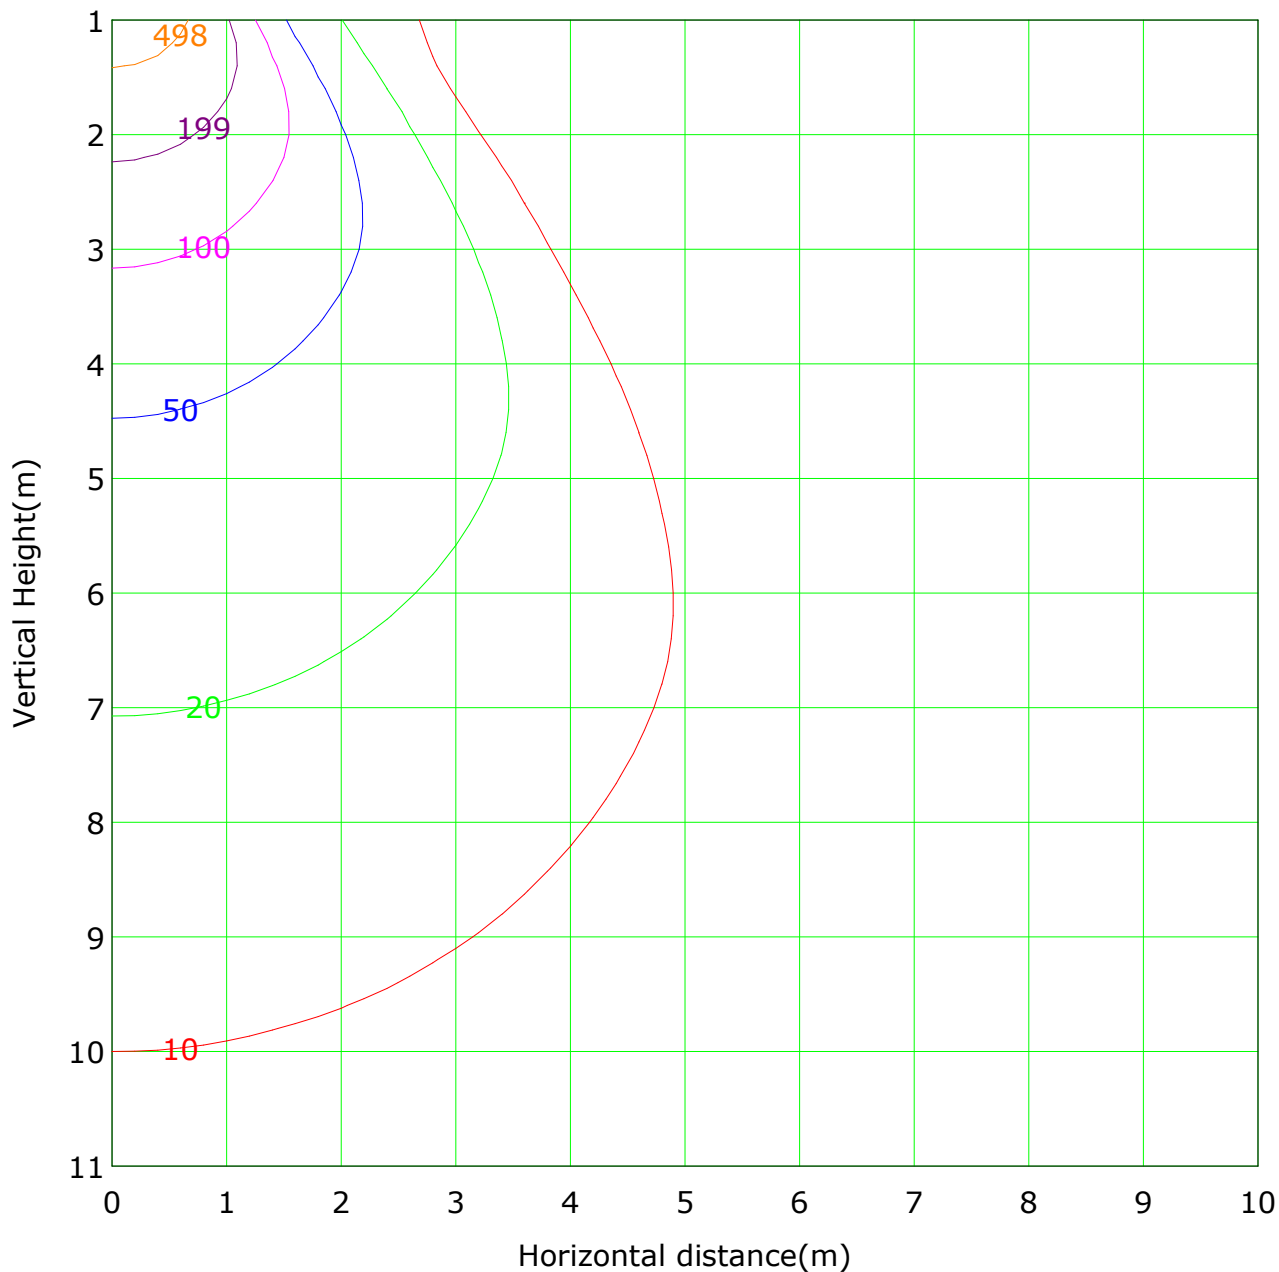

Lowest(m): 1.0m	Highest(m): 11.0m	Max Lux: 996.1 lx
( 1%): 10.0 lx	( 2%): 19.9 lx	
( 5%): 49.8 lx	( 10%): 99.6 lx	
( 20%): 199.2 lx	( 50%): 498.1 lx	
(100%): 996.1 lx		


C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:



## The Average Illuminance Effective Figure

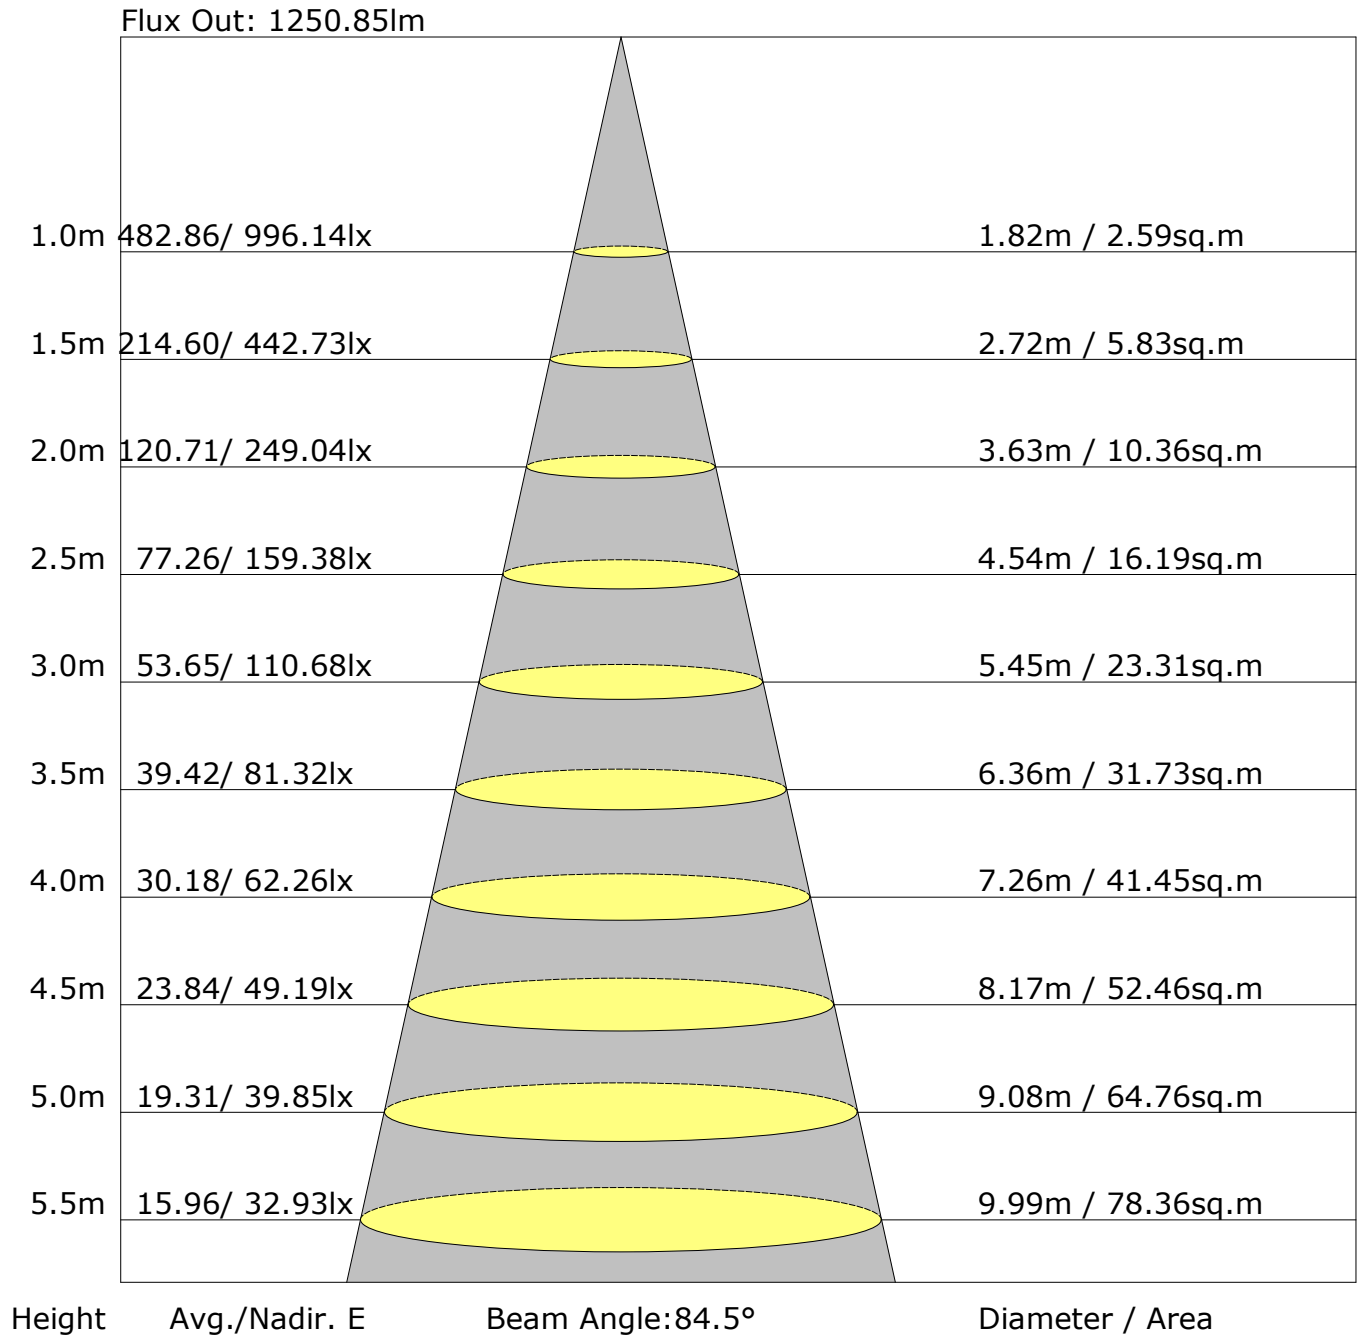

## UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	25.4	26.5	25.6	26.8	27.0	25.3	26.5	25.6	26.7	26.9
3H	26.0	27.1	26.4	27.4	27.6	26.0	27.1	26.3	27.3	27.6
4H	26.5	27.5	26.8	27.8	28.1	26.5	27.5	26.8	27.7	28.0
6H	26.9	27.9	27.3	28.2	28.5	26.9	27.8	27.2	28.1	28.4
8H	27.1	28.0	27.5	28.3	28.6	27.0	27.9	27.4	28.2	28.6
12H	27.3	28.1	27.6	28.4	28.8	27.2	28.0	27.5	28.4	28.7
X=4H Y=2H	25.5	26.6	25.9	26.8	27.1	25.5	26.5	25.8	26.8	27.1
3H	26.5	27.4	26.9	27.7	28.0	26.5	27.3	26.8	27.7	28.0
4H	27.1	27.9	27.5	28.3	28.6	27.1	27.9	27.5	28.2	28.6
6H	27.8	28.4	28.2	28.8	29.2	27.7	28.4	28.1	28.8	29.1
8H	28.0	28.6	28.4	29.0	29.4	27.9	28.6	28.4	29.0	29.4
12H	28.2	28.8	28.7	29.2	29.6	28.2	28.7	28.6	29.1	29.6
X=8H Y=4H	27.4	28.0	27.8	28.4	28.8	27.4	28.0	27.8	28.4	28.8
6H	28.2	28.7	28.6	29.1	29.6	28.1	28.6	28.6	29.1	29.5
8H	28.5	29.0	29.0	29.4	29.9	28.5	28.9	29.0	29.4	29.8
12H	28.9	29.2	29.4	29.7	30.2	28.8	29.2	29.3	29.6	30.1
X=12H Y=4H	27.4	28.0	27.9	28.4	28.8	27.4	27.9	27.8	28.4	28.8
6H	28.3	28.7	28.7	29.1	29.6	28.2	28.6	28.7	29.1	29.6
8H	28.7	29.1	29.2	29.5	30.0	28.6	29.0	29.1	29.5	30.0
Variations with the observer position at spacings:										
S=1.0H	+0.5/-0.7					+0.5/-0.7				
S=1.5H	+1.1/-1.3					+1.1/-1.3				
S=2.0H	+2.1/-1.7					+2.1/-1.7				

Calculate in accordance with CIE Pub.117. The table is revised with  $1831\text{lm}$  ( $8\log(F/F_0) = 2.1$ ).

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

**FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM**

	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	921	50.3
	FL ( 0°-30°)	372	20.3
	FM (30°-60°)	457	25.0
	FH (60°-80°)	81	4.4
	FVH (80°-90°)	11	0.6
	BACK LIGHT	910	49.7
	BL ( 0°-30°)	370	20.2
	BM (30°-60°)	450	24.6
	BH (60°-80°)	80	4.4
	BVH (80°-90°)	11	0.6
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Zonal Lumen

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	996.0	1.0	1.0	0.05	0.05
1.0-2.0	995.5	2.9	3.8	0.16	0.21
2.0-3.0	994.4	4.8	8.6	0.26	0.47
3.0-4.0	992.7	6.6	15.2	0.36	0.83
4.0-5.0	990.5	8.5	23.7	0.47	1.30
5.0-6.0	987.6	10.4	34.1	0.57	1.86
6.0-7.0	984.3	12.2	46.3	0.67	2.53
7.0-8.0	980.4	14.0	60.4	0.77	3.30
8.0-9.0	975.9	15.8	76.2	0.86	4.16
9.0-10.0	971.3	17.6	93.8	0.96	5.12
10.0-11.0	966.3	19.3	113.1	1.05	6.17
11.0-12.0	960.6	21.0	134.1	1.15	7.32
12.0-13.0	954.5	22.7	156.7	1.24	8.56
13.0-14.0	948.1	24.3	181.0	1.33	9.88
14.0-15.0	941.4	25.8	206.8	1.41	11.29
15.0-16.0	934.0	27.4	234.2	1.49	12.79
16.0-17.0	925.9	28.8	263.1	1.57	14.36
17.0-18.0	917.2	30.2	293.3	1.65	16.01
18.0-19.0	908.0	31.6	324.9	1.73	17.74
19.0-20.0	898.2	32.9	357.8	1.80	19.53
20.0-21.0	887.9	34.1	391.9	1.86	21.40
21.0-22.0	876.9	35.2	427.1	1.92	23.32
22.0-23.0	865.4	36.3	463.4	1.98	25.30
23.0-24.0	853.6	37.3	500.8	2.04	27.34
24.0-25.0	841.5	38.3	539.0	2.09	29.43
25.0-26.0	828.8	39.1	578.2	2.14	31.57
26.0-27.0	815.8	39.9	618.1	2.18	33.75
27.0-28.0	802.4	40.6	658.7	2.22	35.97
28.0-29.0	788.3	41.2	700.0	2.25	38.22
29.0-30.0	773.6	41.8	741.7	2.28	40.50
30.0-31.0	758.5	42.2	783.9	2.30	42.80
31.0-32.0	742.9	42.6	826.5	2.32	45.13
32.0-33.0	726.9	42.8	869.3	2.34	47.47
33.0-34.0	710.1	43.0	912.3	2.35	49.81
34.0-35.0	692.6	43.0	955.3	2.35	52.16
35.0-36.0	673.7	42.9	998.2	2.34	54.50

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Zonal Lumen (Continue 1)

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	653.3	42.6	1040.9	2.33	56.83
37.0-38.0	631.0	42.1	1083.0	2.30	59.13
38.0-39.0	606.4	41.4	1124.4	2.26	61.39
39.0-40.0	579.7	40.4	1164.8	2.21	63.60
40.0-41.0	551.3	39.3	1204.1	2.14	65.74
41.0-42.0	521.1	37.9	1241.9	2.07	67.81
42.0-43.0	490.2	36.3	1278.2	1.98	69.79
43.0-44.0	458.9	34.6	1312.9	1.89	71.69
44.0-45.0	427.6	32.9	1345.8	1.79	73.48
45.0-46.0	396.5	31.0	1376.8	1.69	75.17
46.0-47.0	365.9	29.1	1405.9	1.59	76.76
47.0-48.0	336.4	27.2	1433.1	1.49	78.25
48.0-49.0	308.9	25.4	1458.4	1.39	79.63
49.0-50.0	283.5	23.6	1482.1	1.29	80.92
50.0-51.0	260.5	22.0	1504.1	1.20	82.13
51.0-52.0	239.9	20.6	1524.7	1.12	83.25
52.0-53.0	221.4	19.3	1544.0	1.05	84.30
53.0-54.0	204.8	18.1	1562.0	0.99	85.29
54.0-55.0	189.6	16.9	1579.0	0.92	86.21
55.0-56.0	175.4	15.9	1594.8	0.87	87.08
56.0-57.0	162.2	14.8	1609.6	0.81	87.89
57.0-58.0	149.8	13.9	1623.5	0.76	88.64
58.0-59.0	138.6	13.0	1636.4	0.71	89.35
59.0-60.0	128.5	12.1	1648.6	0.66	90.01
60.0-61.0	119.6	11.4	1660.0	0.62	90.64
61.0-62.0	111.9	10.8	1670.8	0.59	91.23
62.0-63.0	105.6	10.3	1681.1	0.56	91.79
63.0-64.0	100.2	9.8	1690.9	0.54	92.32
64.0-65.0	95.6	9.5	1700.4	0.52	92.84
65.0-66.0	91.7	9.2	1709.5	0.50	93.34
66.0-67.0	88.4	8.9	1718.4	0.49	93.83
67.0-68.0	85.4	8.7	1727.1	0.47	94.30
68.0-69.0	82.8	8.4	1735.5	0.46	94.76
69.0-70.0	80.4	8.3	1743.8	0.45	95.21
70.0-71.0	77.8	8.0	1751.8	0.44	95.65
71.0-72.0	75.0	7.8	1759.6	0.43	96.08

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	996.1	996.1								
G1.0	996.4	995.3								
G2.0	995.9	994.5								
G3.0	994.7	992.6								
G4.0	992.9	990.7								
G5.0	990.1	988.2								
G6.0	986.9	985.1								
G7.0	983.8	981.5								
G8.0	979.3	976.8								
G9.0	975.2	972.1								
G10.0	971.1	966.8								
G11.0	966.3	961.0								
G12.0	960.8	954.5								
G13.0	954.9	947.8								
G14.0	948.6	941.0								
G15.0	941.7	934.2								
G16.0	933.6	926.5								
G17.0	925.0	918.4								
G18.0	916.8	908.7								
G19.0	908.3	898.0								
G20.0	899.1	887.5								
G21.0	889.0	876.2								
G22.0	878.1	864.5								
G23.0	866.6	852.4								
G24.0	854.8	840.8								
G25.0	842.7	827.8								
G26.0	830.6	814.3								
G27.0	817.5	800.9								
G28.0	804.3	786.9								
G29.0	790.1	771.7								
G30.0	775.7	756.7								
G31.0	760.8	740.6								
G32.0	745.4	724.8								
G33.0	728.8	708.5								
G34.0	712.1	691.3								
G35.0	694.1	673.0								
G36.0	674.6	653.2								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

## Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	653.2	632.0								
G38.0	629.7	608.9								
G39.0	603.6	583.3								
G40.0	575.8	556.3								
G41.0	545.8	527.2								
G42.0	514.5	496.9								
G43.0	483.6	465.7								
G44.0	452.3	434.2								
G45.0	421.1	402.6								
G46.0	390.6	371.6								
G47.0	360.3	341.2								
G48.0	330.9	313.4								
G49.0	303.3	288.0								
G50.0	277.6	265.1								
G51.0	254.1	245.0								
G52.0	233.6	226.8								
G53.0	215.1	210.1								
G54.0	199.0	194.9								
G55.0	183.8	180.8								
G56.0	169.8	167.4								
G57.0	156.5	155.1								
G58.0	144.3	143.3								
G59.0	133.6	133.0								
G60.0	123.9	123.6								
G61.0	115.5	115.4								
G62.0	108.5	108.4								
G63.0	102.7	102.8								
G64.0	98.0	97.3								
G65.0	94.0	93.0								
G66.0	90.6	89.2								
G67.0	87.7	86.0								
G68.0	85.2	82.8								
G69.0	82.8	80.4								
G70.0	80.3	78.2								
G71.0	77.2	75.7								
G72.0	74.4	72.6								
G73.0	71.3	69.6								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:



Unit: cd

[illegible]

Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector: