

Report No.:

Test Time: 2025-10-08 14:49

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: 35D

Luminous Width (mm): -96

Current: 0.174 A

Power Factor: 0.980

Luminous Length (mm): -96

Voltage: 227.0 V

Power: 38.70 W

Photometric Results

CIE Class: Direct

Measurement Flux: 5126.8 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H31.8

Vertical Diffuse Angle(50%): V31.8

Luminaire Efficacy Rating (LER): 132.53

Max. Intensity: 12838.14 cd

S/MH(C0/C180): 0.53

Total Rated Lamp Lumens: 5126.8 lm

Efficiency: 100%

Upward Ratio: 0%

Central Intensity: 12838.14 cd


Pos of Max. Intensity: H0 V0

S/MH(C90/C270): 0.53

Picture Of Luminaire



Luminous Intensity Distribution Curve

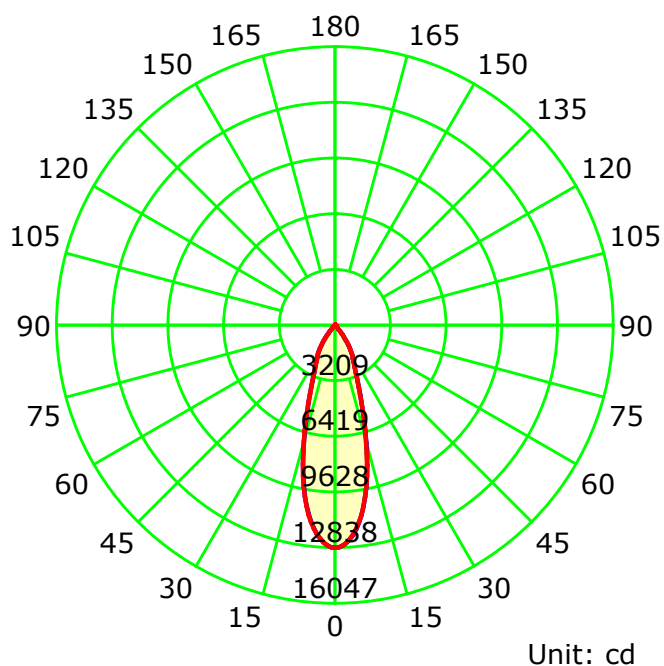

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

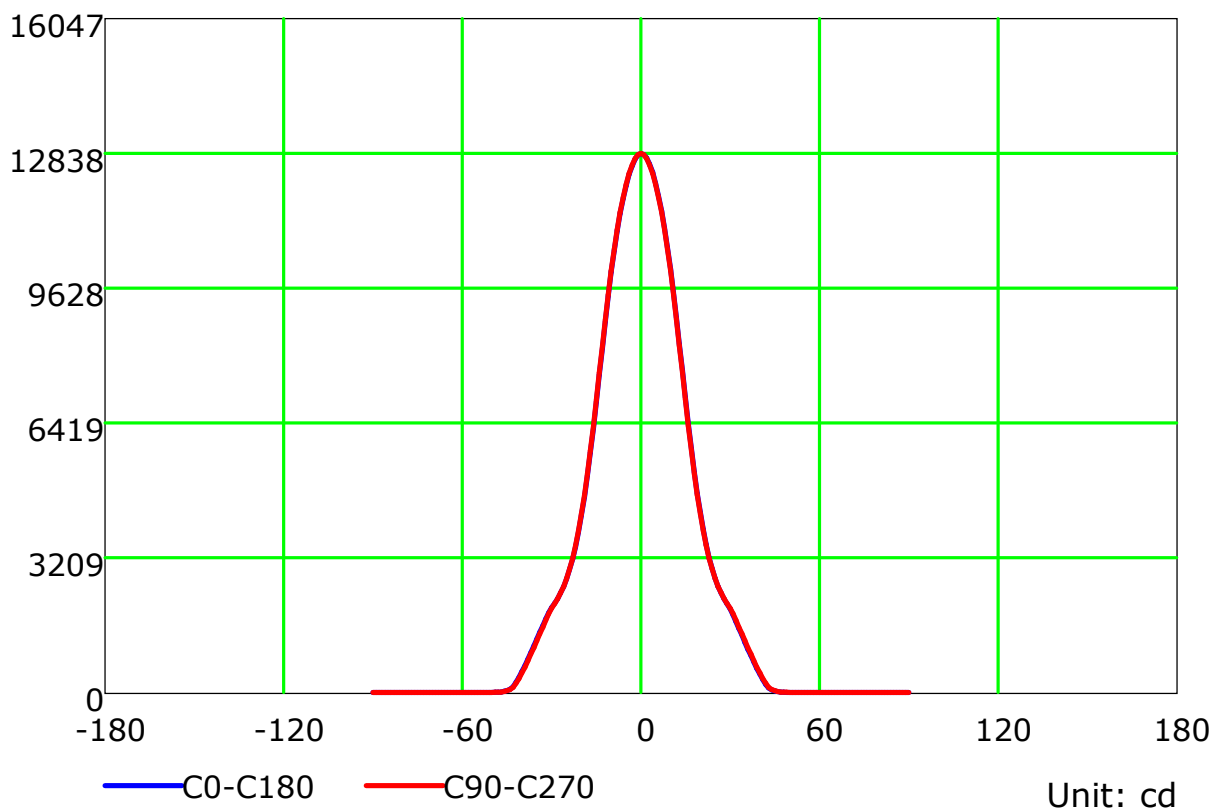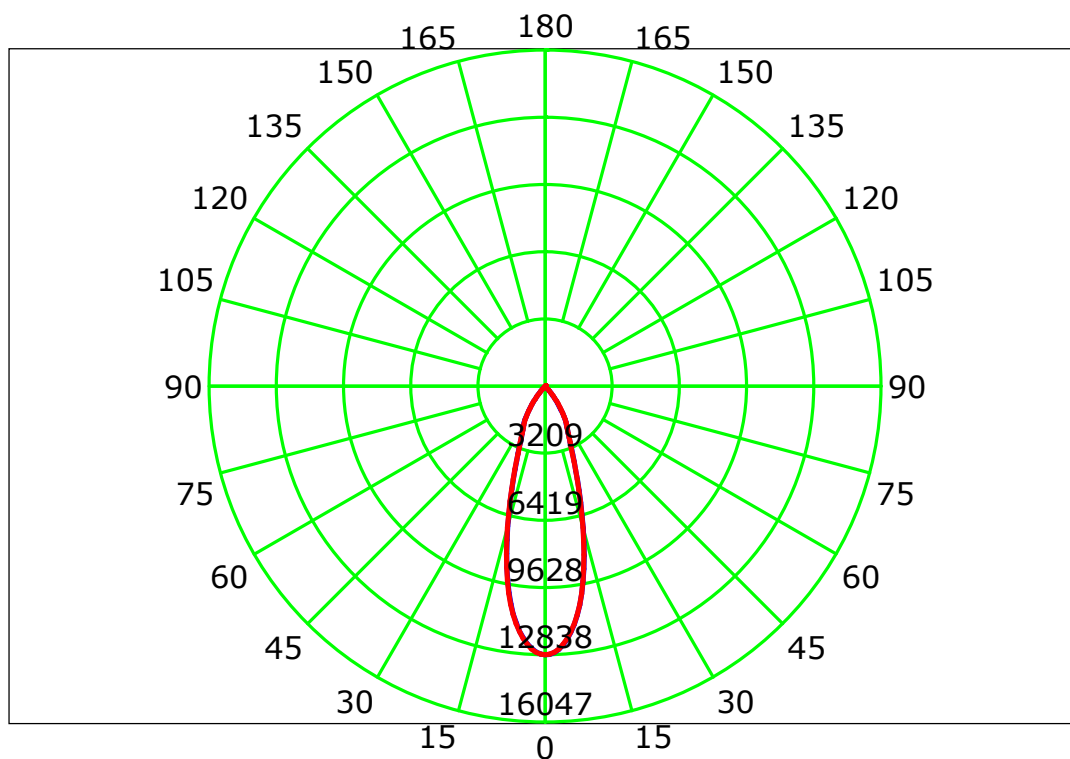

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

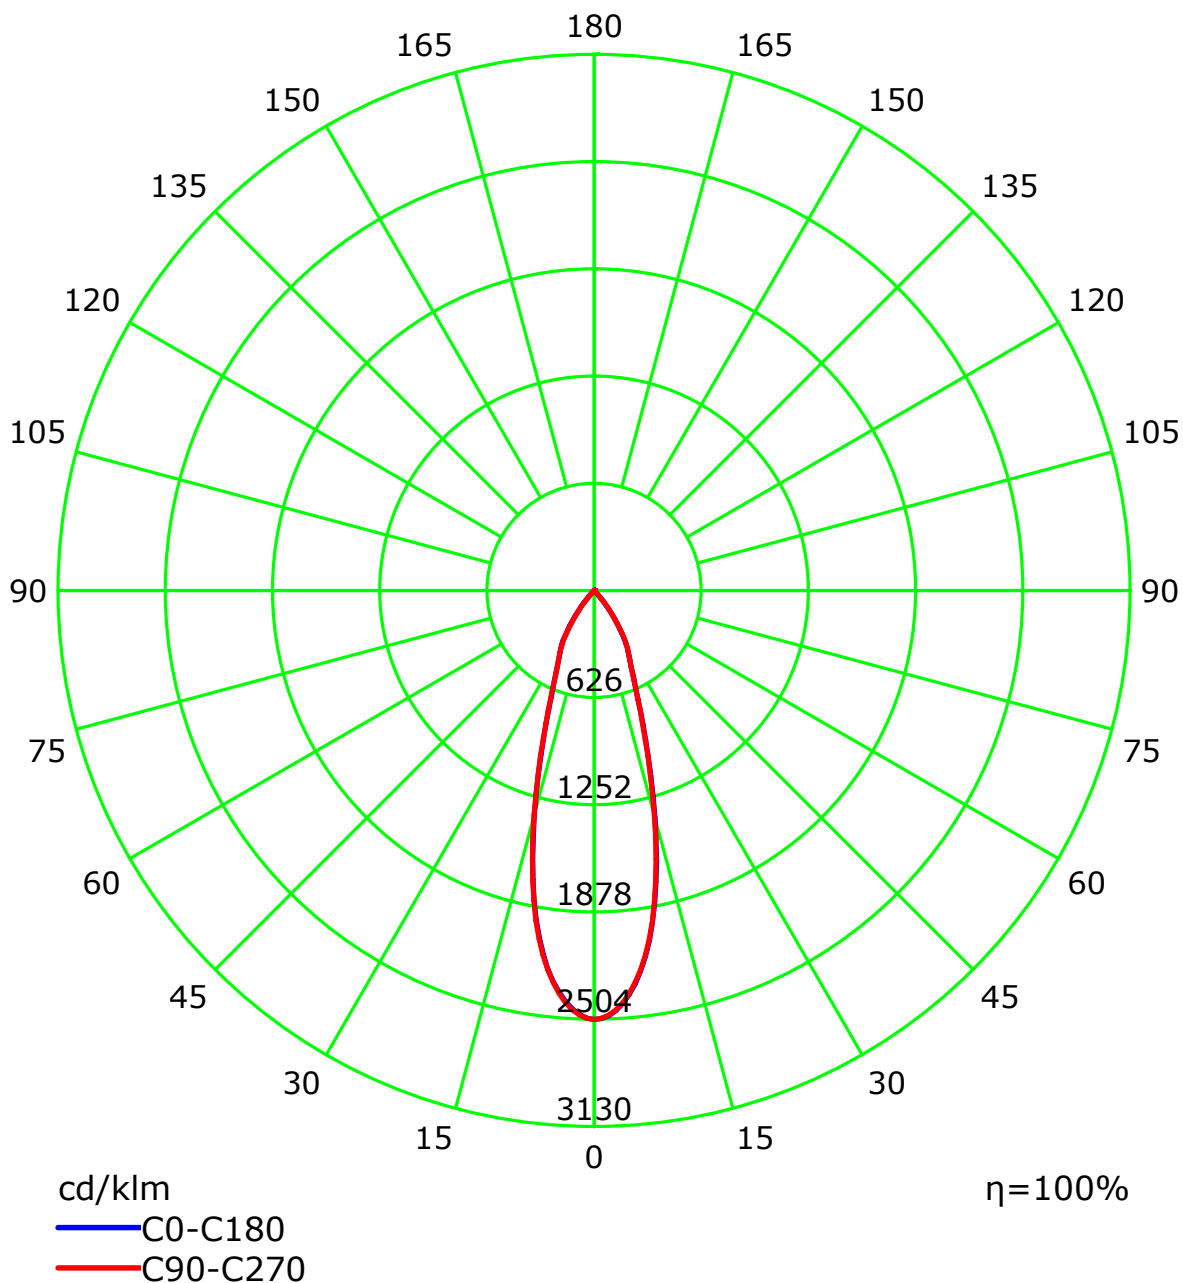

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Isocandela (rectangle)

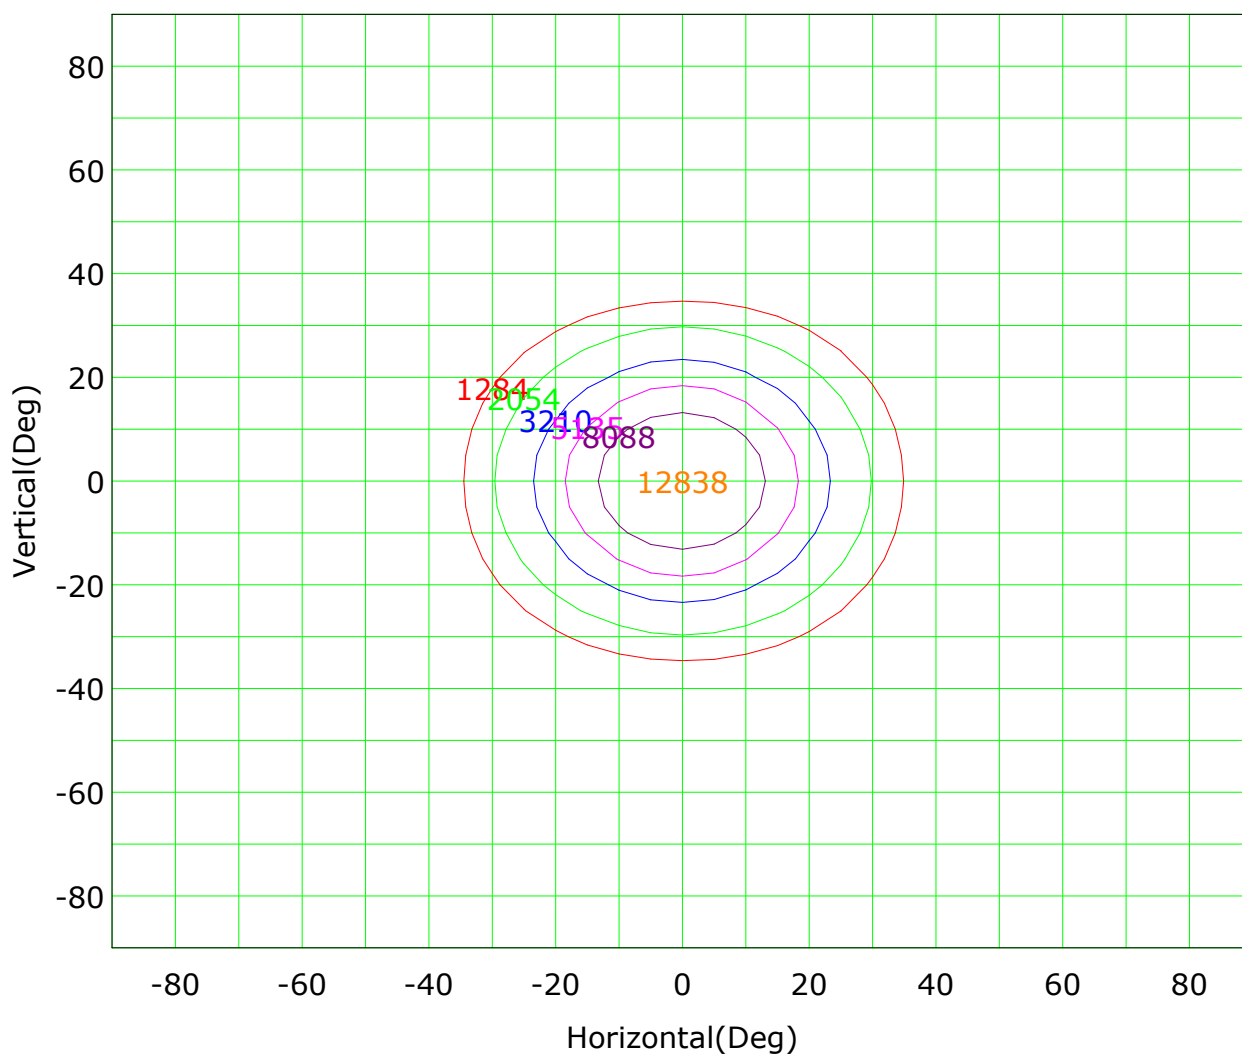


Imax (100%): 12838 cd

(10%): 1284 cd	(16%): 2054 cd
(25%): 3210 cd	(40%): 5135 cd
(63%): 8088 cd	(100%): 12838 cd

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

IsoLux Plot

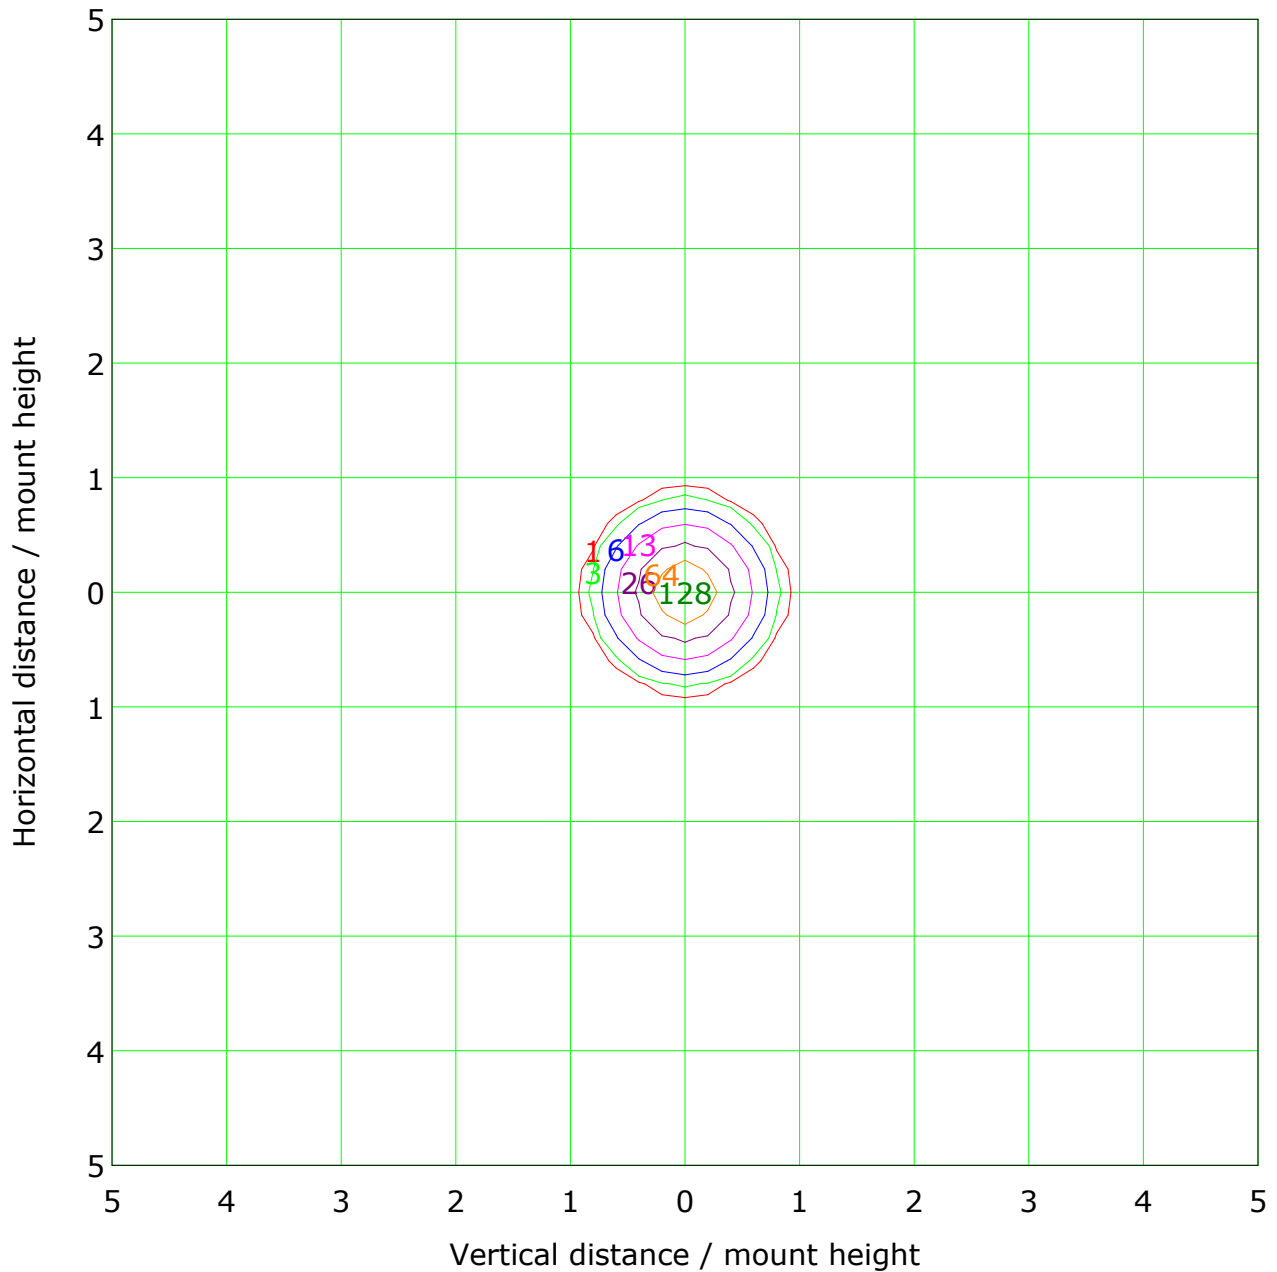


Mounting Height: 10.0m Max Lux(100%): 128.4 lx

(1%): 1.3 lx	(2%): 2.6 lx
(5%): 6.4 lx	(10%): 12.8 lx
(20%): 25.7 lx	(50%): 64.2 lx
(100%): 128.4 lx	


C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Illuminance at a Distance

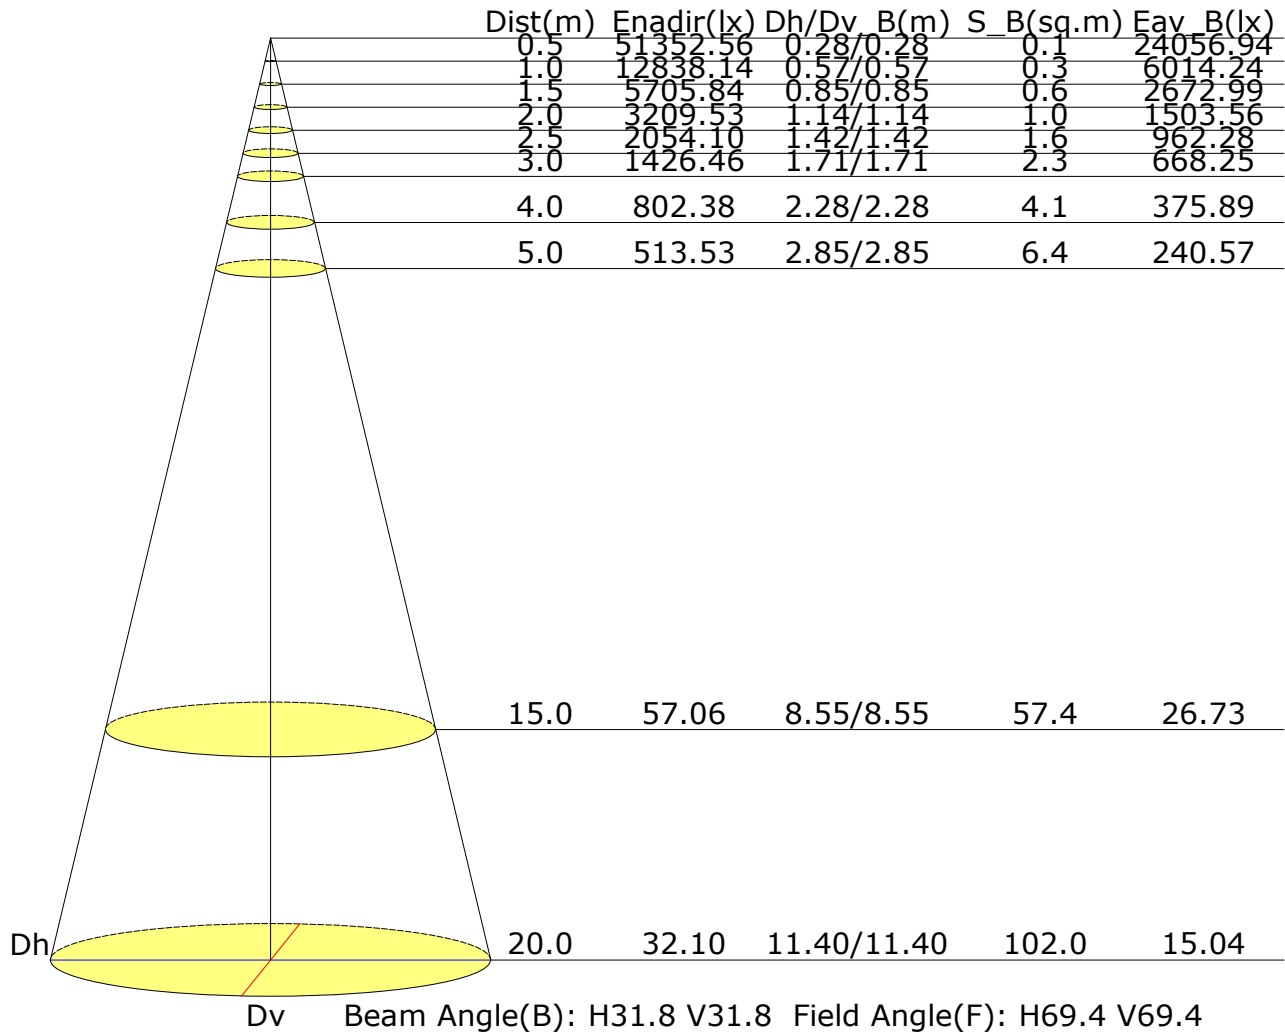

Vertical IsoLux Plot

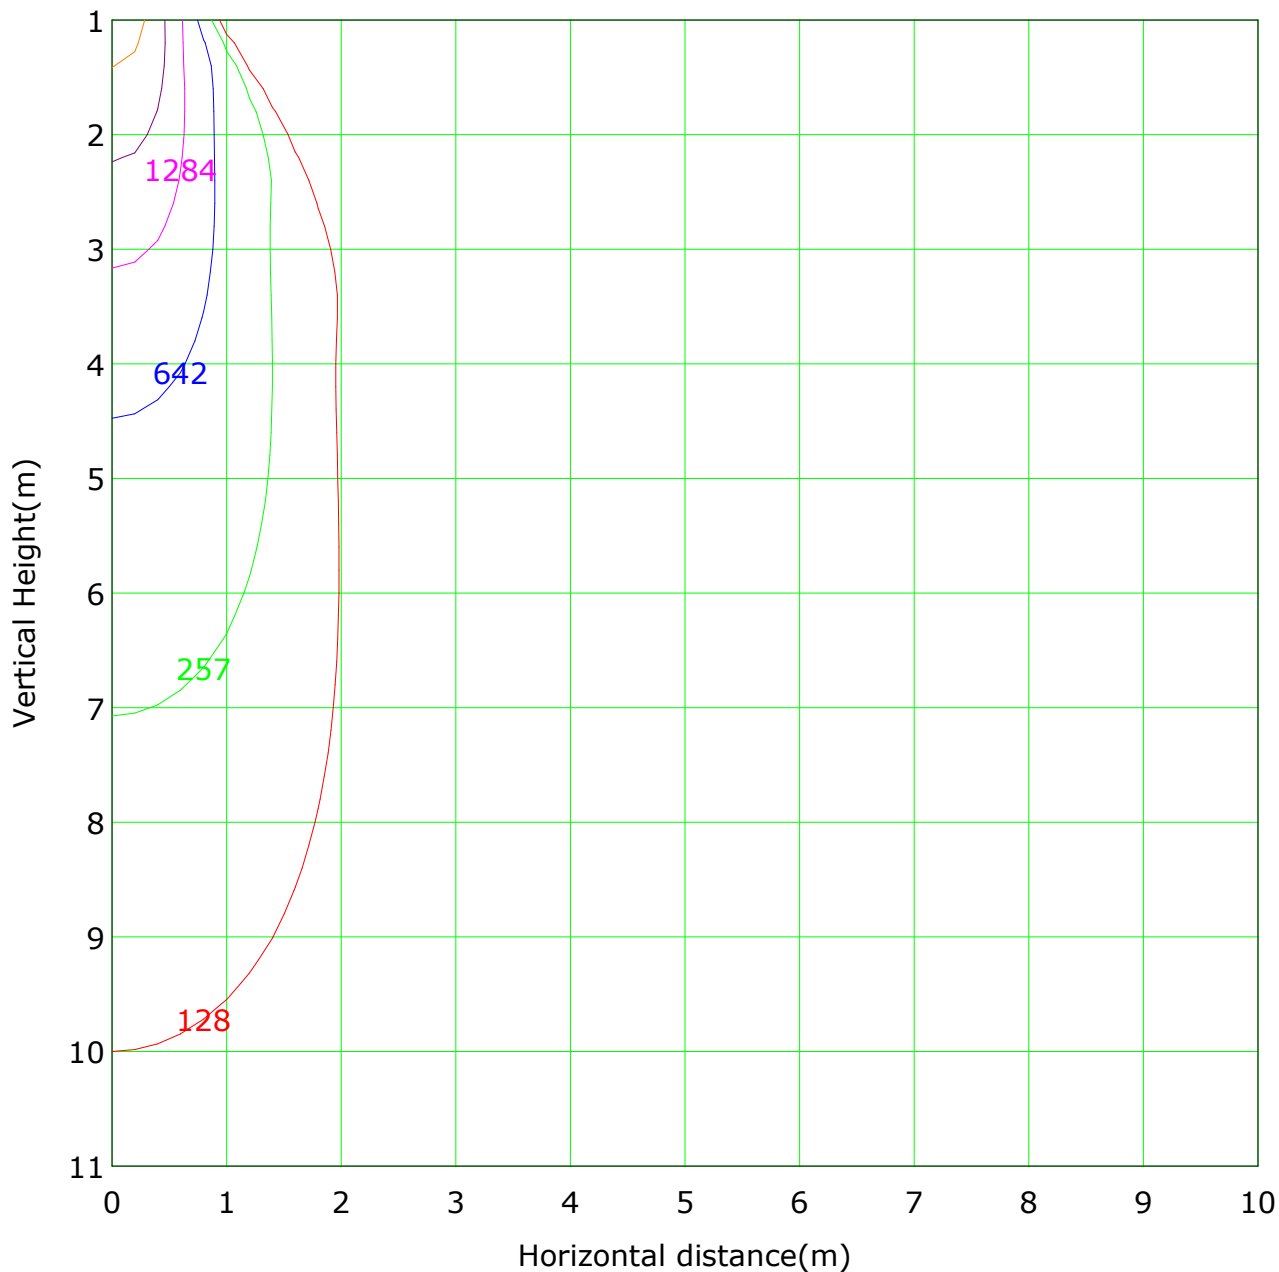

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 12838.1 lx


— (1%): 128.4 lx	— (2%): 256.8 lx
— (5%): 641.9 lx	— (10%): 1283.8 lx
— (20%): 2567.6 lx	— (50%): 6419.1 lx
— (100%): 12838.1 lx	

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

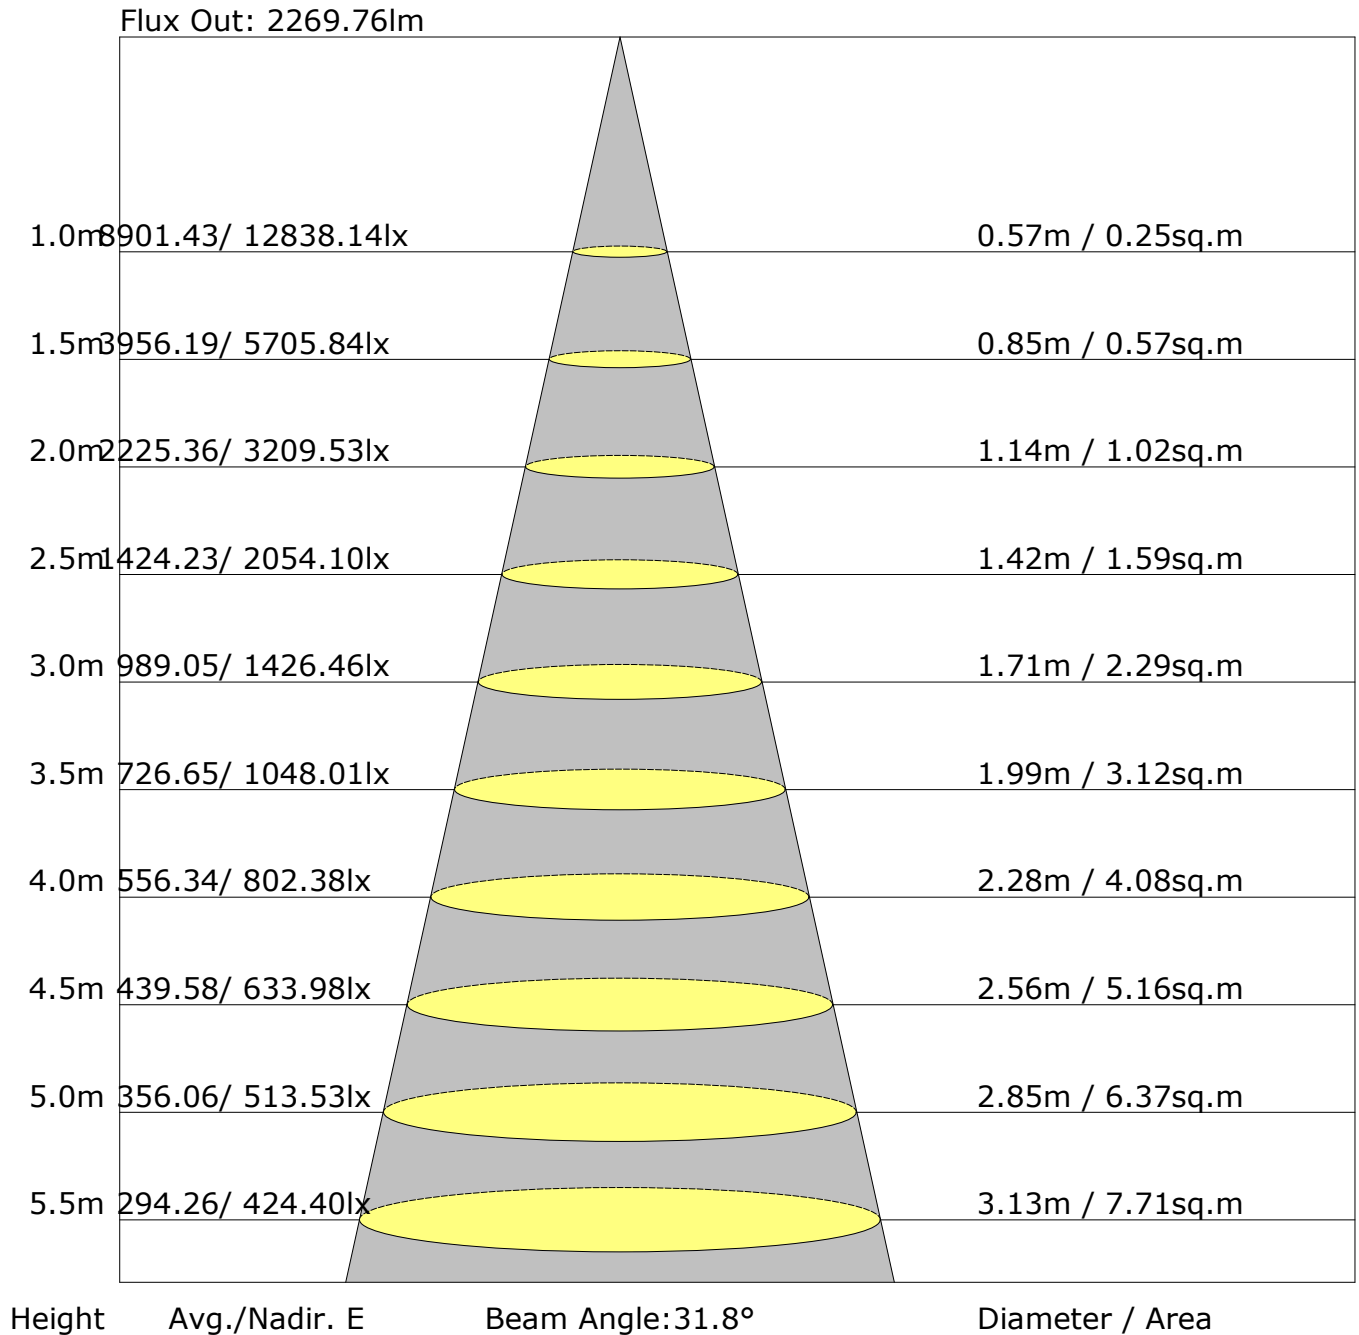

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	20.0	20.7	20.3	20.9	21.1	20.1	20.9	20.4	21.0	21.2
3H	19.9	20.5	20.1	20.8	21.0	20.0	20.6	20.3	20.9	21.1
4H	19.8	20.4	20.1	20.7	20.9	19.9	20.5	20.2	20.8	21.0
6H	19.7	20.3	20.0	20.6	20.9	19.8	20.4	20.2	20.7	21.0
8H	19.7	20.2	20.0	20.5	20.8	19.8	20.4	20.1	20.6	20.9
12H	19.6	20.2	20.0	20.5	20.8	19.8	20.3	20.1	20.6	20.9
X=4H Y=2H	19.8	20.4	20.1	20.7	20.9	19.9	20.5	20.2	20.8	21.0
3H	19.6	20.2	20.0	20.5	20.8	19.8	20.3	20.1	20.6	20.9
4H	19.6	20.0	19.9	20.4	20.7	19.7	20.1	20.1	20.5	20.8
6H	19.5	19.9	19.9	20.2	20.6	19.6	20.0	20.0	20.4	20.8
8H	19.4	19.8	19.8	20.2	20.6	19.5	19.9	20.0	20.3	20.7
12H	19.4	19.7	19.8	20.1	20.6	19.5	19.8	19.9	20.2	20.7
X=8H Y=4H	19.4	19.8	19.8	20.2	20.6	19.5	19.9	20.0	20.3	20.7
6H	19.3	19.6	19.8	20.1	20.5	19.4	19.8	19.9	20.2	20.6
8H	19.3	19.5	19.7	20.0	20.5	19.4	19.7	19.9	20.1	20.6
12H	19.2	19.5	19.7	19.9	20.4	19.4	19.6	19.8	20.1	20.6
X=12H Y=4H	19.4	19.7	19.8	20.1	20.6	19.5	19.8	19.9	20.2	20.7
6H	19.3	19.5	19.7	20.0	20.5	19.4	19.7	19.9	20.1	20.6
8H	19.2	19.5	19.7	19.9	20.4	19.4	19.6	19.8	20.1	20.6
Variations with the observer position at spacings:										
S=1.0H	+5.7/-1.\$					+5.7/-1.\$				
S=1.5H	+8.5/-1.\$					+8.5/-1.\$				
S=2.0H	+10.5/-1.\$					+10.5/-1.\$				

Calculate in accordance with CIE Pub.117. The table is revised with 5127lm ($8\log(F/F_0) = 5.7$).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	2561	49.9
	FL (0°-30°)	2148	41.9
	FM (30°-60°)	412	8.0
	FH (60°-80°)	0	0.0
	FVH (80°-90°)	0	0.0
	BACK LIGHT	2566	50.1
	BL (0°-30°)	2139	41.7
	BM (30°-60°)	427	8.3
	BH (60°-80°)	0	0.0
	BVH (80°-90°)	0	0.0
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	12823.7	12.3	12.3	0.24	0.24
1.0-2.0	12763.7	36.6	48.9	0.71	0.95
2.0-3.0	12643.3	60.5	109.4	1.18	2.13
3.0-4.0	12465.6	83.5	192.8	1.63	3.76
4.0-5.0	12232.5	105.2	298.1	2.05	5.81
5.0-6.0	11950.6	125.6	423.7	2.45	8.26
6.0-7.0	11618.9	144.2	567.9	2.81	11.08
7.0-8.0	11233.7	160.8	728.7	3.14	14.21
8.0-9.0	10797.3	175.0	903.7	3.41	17.63
9.0-10.0	10306.9	186.5	1090.3	3.64	21.27
10.0-11.0	9764.5	195.1	1285.4	3.81	25.07
11.0-12.0	9182.7	200.8	1486.2	3.92	28.99
12.0-13.0	8570.5	203.4	1689.6	3.97	32.96
13.0-14.0	7937.1	203.2	1892.8	3.96	36.92
14.0-15.0	7299.2	200.4	2093.2	3.91	40.83
15.0-16.0	6669.4	195.5	2288.7	3.81	44.64
16.0-17.0	6059.2	188.7	2477.4	3.68	48.32
17.0-18.0	5485.6	180.9	2658.3	3.53	51.85
18.0-19.0	4957.9	172.5	2830.8	3.36	55.22
19.0-20.0	4479.0	164.0	2994.7	3.20	58.41
20.0-21.0	4052.1	155.6	3150.4	3.04	61.45
21.0-22.0	3675.8	147.7	3298.1	2.88	64.33
22.0-23.0	3348.2	140.5	3438.6	2.74	67.07
23.0-24.0	3067.0	134.1	3572.7	2.62	69.69
24.0-25.0	2827.2	128.6	3701.3	2.51	72.19
25.0-26.0	2623.6	123.9	3825.1	2.42	74.61
26.0-27.0	2450.9	119.9	3945.1	2.34	76.95
27.0-28.0	2303.1	116.6	4061.7	2.27	79.22
28.0-29.0	2177.4	113.9	4175.6	2.22	81.45
29.0-30.0	2065.4	111.5	4287.1	2.18	83.62
30.0-31.0	1944.6	108.2	4395.4	2.11	85.73
31.0-32.0	1801.4	103.2	4498.6	2.01	87.75
32.0-33.0	1643.4	96.8	4595.4	1.89	89.64
33.0-34.0	1481.9	89.7	4685.1	1.75	91.38
34.0-35.0	1318.6	81.9	4767.0	1.60	92.98
35.0-36.0	1154.7	73.5	4840.5	1.43	94.42

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	994.6	64.9	4905.4	1.27	95.68
37.0-38.0	837.3	55.9	4961.3	1.09	96.77
38.0-39.0	684.2	46.7	5008.0	0.91	97.68
39.0-40.0	538.2	37.5	5045.6	0.73	98.42
40.0-41.0	400.9	28.6	5074.1	0.56	98.97
41.0-42.0	278.1	20.2	5094.3	0.39	99.37
42.0-43.0	174.5	12.9	5107.2	0.25	99.62
43.0-44.0	99.4	7.5	5114.7	0.15	99.76
44.0-45.0	59.0	4.5	5119.3	0.09	99.85
45.0-46.0	37.9	3.0	5122.2	0.06	99.91
46.0-47.0	20.4	1.6	5123.9	0.03	99.94
47.0-48.0	10.9	0.9	5124.7	0.02	99.96
48.0-49.0	9.1	0.7	5125.5	0.01	99.97
49.0-50.0	7.0	0.6	5126.1	0.01	99.99
50.0-51.0	4.2	0.4	5126.4	0.01	99.99
51.0-52.0	2.5	0.2	5126.6	0.00	100.00
52.0-53.0	1.4	0.1	5126.8	0.00	100.00
53.0-54.0	0.3	0.0	5126.8	0.00	100.00
54.0-55.0	0.0	0.0	5126.8	0.00	100.00
55.0-56.0	0.0	0.0	5126.8	0.00	100.00
56.0-57.0	0.0	0.0	5126.8	0.00	100.00
57.0-58.0	0.0	0.0	5126.8	0.00	100.00
58.0-59.0	0.0	0.0	5126.8	0.00	100.00
59.0-60.0	0.0	0.0	5126.8	0.00	100.00
60.0-61.0	0.0	0.0	5126.8	0.00	100.00
61.0-62.0	0.0	0.0	5126.8	0.00	100.00
62.0-63.0	0.0	0.0	5126.8	0.00	100.00
63.0-64.0	0.0	0.0	5126.8	0.00	100.00
64.0-65.0	0.0	0.0	5126.8	0.00	100.00
65.0-66.0	0.0	0.0	5126.8	0.00	100.00
66.0-67.0	0.0	0.0	5126.8	0.00	100.00
67.0-68.0	0.0	0.0	5126.8	0.00	100.00
68.0-69.0	0.0	0.0	5126.8	0.00	100.00
69.0-70.0	0.0	0.0	5126.8	0.00	100.00
70.0-71.0	0.0	0.0	5126.8	0.00	100.00
71.0-72.0	0.0	0.0	5126.8	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	12838.1	12838.1								
G1.0	12814.3	12804.4								
G2.0	12734.2	12701.9								
G3.0	12589.6	12547.5								
G4.0	12388.8	12336.8								
G5.0	12129.0	12075.6								
G6.0	11825.6	11772.3								
G7.0	11467.5	11410.0								
G8.0	11058.9	10998.5								
G9.0	10599.7	10532.3								
G10.0	10084.3	10011.3								
G11.0	9519.8	9442.5								
G12.0	8928.6	8840.1								
G13.0	8307.9	8205.3								
G14.0	7671.7	7563.6								
G15.0	7035.6	6926.0								
G16.0	6413.5	6302.5								
G17.0	5808.2	5712.7								
G18.0	5252.1	5169.2								
G19.0	4746.5	4663.7								
G20.0	4288.7	4217.1								
G21.0	3881.5	3821.1								
G22.0	3524.8	3475.6								
G23.0	3210.2	3182.1								
G24.0	2946.2	2929.4								
G25.0	2721.5	2711.7								
G26.0	2530.6	2530.6								
G27.0	2367.7	2374.7								
G28.0	2230.0	2239.9								
G29.0	2112.1	2127.5								
G30.0	1994.1	2027.8								
G31.0	1852.3	1904.2								
G32.0	1690.8	1758.2								
G33.0	1525.1	1599.5								
G34.0	1365.0	1438.0								
G35.0	1196.5	1275.1								
G36.0	1033.6	1113.6								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	879.1	952.1								
G38.0	724.6	793.4								
G39.0	574.4	644.6								
G40.0	435.3	498.5								
G41.0	307.5	362.3								
G42.0	198.0	244.4								
G43.0	110.9	144.6								
G44.0	61.8	80.1								
G45.0	40.7	53.4								
G46.0	25.3	32.3								
G47.0	11.2	12.6								
G48.0	8.4	11.2								
G49.0	7.0	9.8								
G50.0	4.2	7.0								
G51.0	1.4	4.2								
G52.0	2.8	1.4								
G53.0	0.0	1.4								
G54.0	0.0	0.0								
G55.0	0.0	0.0								
G56.0	0.0	0.0								
G57.0	0.0	0.0								
G58.0	0.0	0.0								
G59.0	0.0	0.0								
G60.0	0.0	0.0								
G61.0	0.0	0.0								
G62.0	0.0	0.0								
G63.0	0.0	0.0								
G64.0	0.0	0.0								
G65.0	0.0	0.0								
G66.0	0.0	0.0								
G67.0	0.0	0.0								
G68.0	0.0	0.0								
G69.0	0.0	0.0								
G70.0	0.0	0.0								
G71.0	0.0	0.0								
G72.0	0.0	0.0								
G73.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

Unit: cd

[illegible]

Inspector: